

VUE 270 V5B EC A21





Heat recovery air handling units in sound- and heat-insulated casings equipped with an enthalpy counter-flow heat exchanger

- Maximum airflow: 300
- Sound pressure level LpA at 3 m: 34
- Heat exchanger type: Counter flow
- Extract filter: G4
- Supply filter: G4 (option F8)
- Sound insulation
- Motor type: EC
- Enthalpy heat exchanger
- Bypass: Auto
- Reheater: Optional
- Preheater: Optional
- BMS protocol: ModBus
- Control: Smartphone
- Casing material: EPP
- Humidity sensor: Optional
- CO2 sensor: Optional
- VOC sensor: Optional
- PM2.5 sensor: Optional


	Unit of measurement	VUE 270 V5B EC A21
Connected air duct size	mm	125
Speed	-	1
Minimum supply voltage	V	230
Maximum supply voltage	V	230
Power supply frequency	Hz	50/60
Rated power	W	162
Unit current	A	1.2
Maximum airflow	m ³ /h	300
Sound pressure level LpA at 3 m	dB(A)	34
Heat recovery efficiency, max	%	94
Heat exchanger type	-	Counter flow
Heat exchanger material	-	Enthalpy
Weight	kg	13.5
Extract filter	-	G4
Supply filter	-	G4 (option F8)
Transported air temperature (max)	°C	40
Transported air temperature (min)	°C	-25
Ambient air temperature min	°C	1
Ambient air temperature max	°C	40
Ambient air humidity max	%	60
Ingress protection rating	-	IP22

Ingress protection rating of the drive	-	IP44
--	---	------

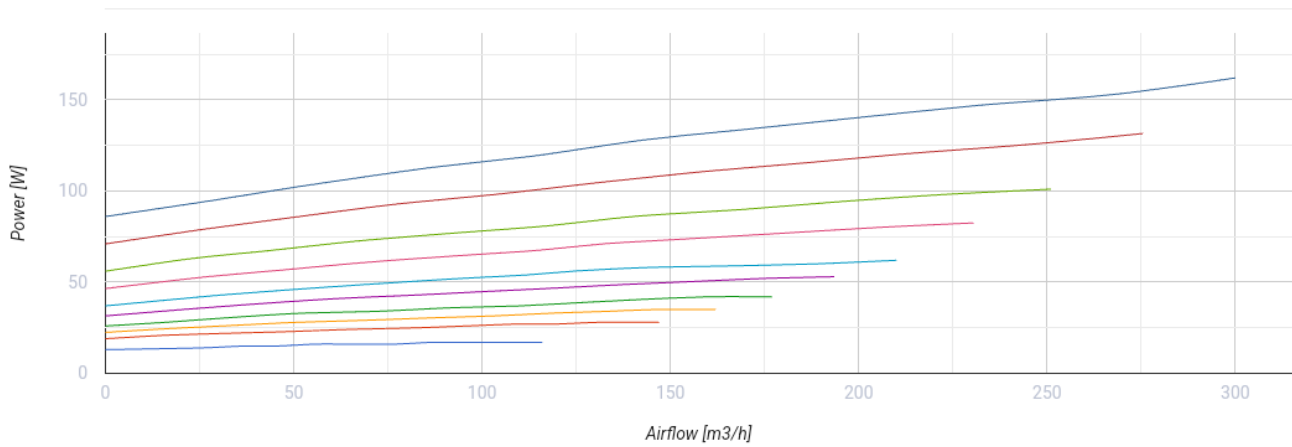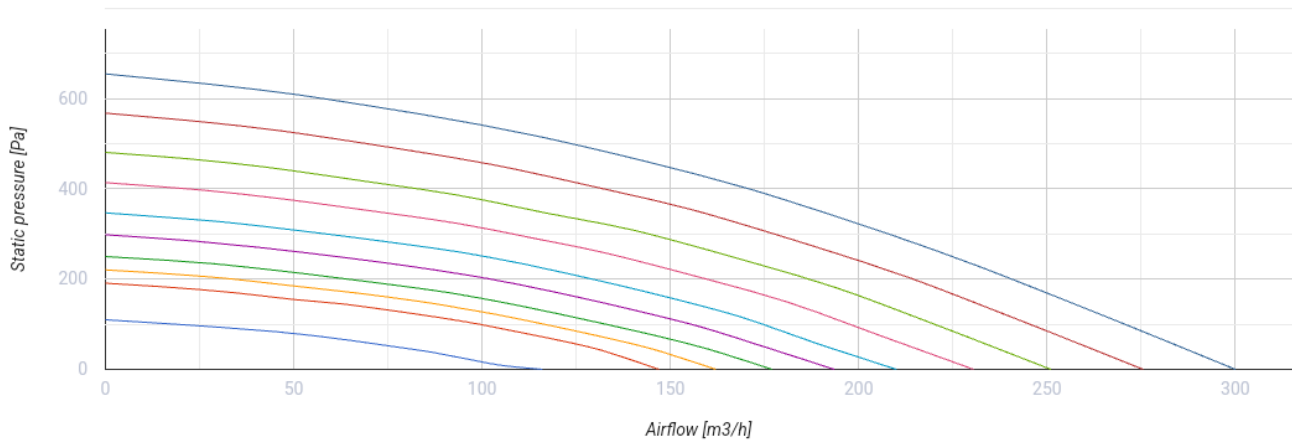




Dimensions

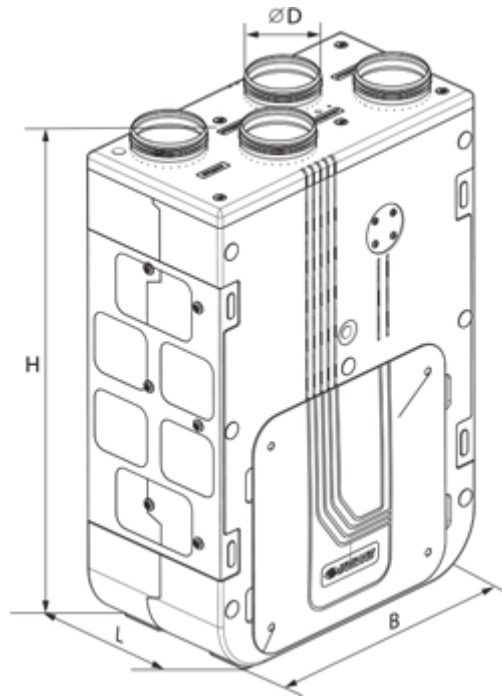ØD	B	H	L
125	590	893	316







Accessories

Control Panels for AHU



Name	Photo	Description
A25		The control panel with a sensor display
A22		The A22/A22 WiFi control panels are used for control of industrial and domestic air handling units with an A21 automation system.
A22 WiFi		The A22/A22 WiFi control panels are used for control of industrial and domestic air handling units with an A21 automation system.

Sensors



Name	Photo	Description
HV2		Humidity sensor
CO2-1		CO2 sensors
CO2-2		CO2 sensors
HR-S		Electro-mechanical humidistats

DPWC11200		Humidity sensor
---------------------------	---	-----------------


VOC sensors

Name	Photo	Description
DPWQ30600		VOC sensors
DPWQ40200		CO2 sensor

Electrical heaters

Name	Photo	Description
NKD 125-0,6-1 A21 V.2		Duct heater for supply air post-heating with external control
NKD 125-0,8-1 A21 V.2		Duct heater for supply air post-heating with external control
NKD 125-1,2-1 A21 V.2		Duct heater for supply air post-heating with external control
NKP 125-0,6-1 A21 V.2		Heater for heat exchanger freeze protection
NKP 125-0,8-1 A21 V.2		Heater for heat exchanger freeze protection
NKP 125-1,2-1 A21 V.2		Heater for heat exchanger freeze protection

Electric actuators

Name	Photo	Description
Belimo LF230		The Belimo LF series actuators are designed for controlling air dampers with cross section up to 0.8 m ² performing protection functions



For round ducts

Name	Photo	Description
------	-------	-------------


[KRV 125](#)

Air damper for air flow cut-off in round air ducts

Other accessories

Name	Photo	Description
SF 264x182x18 G4		Panel filter G4
SF 264x182x18 F8		F8 panel filter

Ecodesign

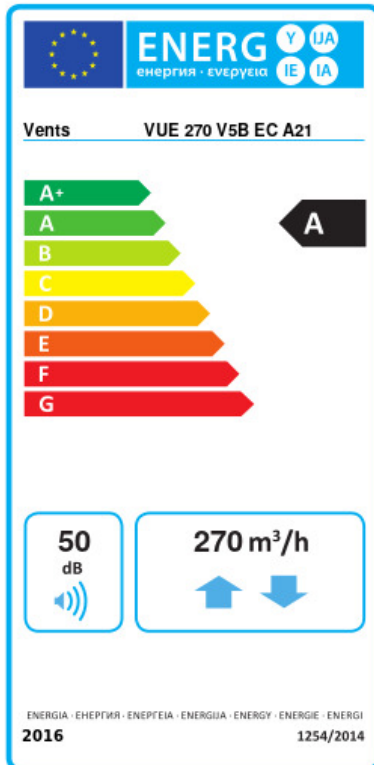

Trademark	Vents					
Model	VUE 270 V5B EC A21					
Specific energy consumption (SEC) (kWh/(m ² /a))	Cold		Average		Warm	
	77.8	A+	40.2	A	16.1	E
Type of ventilation unit	Bidirectional					
Type of drive installed	Variable speed					
Type of heat recovery system	Recuperative					
Thermal efficiency of heat recovery (%)	80					
Maximum flow rate (m ³ /h)	270					
Electric power input (W)	153					
Reference flow rate (m ³ /s)	0.053					
Reference pressure difference (Pa)	50					
Specific power input (SPI) (W/(m ³ /h))	0.316					
Control typology	Local demand control					
Maximum internal leakage rates (%)	2.7					
Maximum external leakage rates (%)	2.7					
Sound power level (dB(A))	50					
Declared typology	RVU BVU					
The annual electricity consumption (AEC) (kWh/a)	Cold		Average		Warm	
	749		212		167	
The annual heating saved (AHS) (kWh/a)	Cold		Average		Warm	
	8776		4486		2029	