

# VUE 700 HBE EC A21





Heat recovery air handling units in sound- and heat-insulated casings equipped with an enthalpy counter-flow heat exchanger

- Power of electrical reheater: 3600
- Maximum airflow: 830
- Sound pressure level LpA at 3 m: 31
- Heat exchanger type: Counter flow
- Extract filter: G4
- Supply filter: G4+F7
- Sound insulation
- Motor type: EC
- Enthalpy heat exchanger
- Bypass: Auto
- Reheater: Electric
- Preheater: Optional
- BMS protocol: ModBus
- Control: Smartphone
- Casing material: Galvanized steel
- Humidity sensor: Optional
- CO2 sensor: Optional
- VOC sensor: Optional
- PM2.5 sensor: Optional

|                                   | Unit of measurement | VUE 700 HBE EC A21 |
|-----------------------------------|---------------------|--------------------|
| Connected air duct size           | mm                  | 250                |
| Speed                             | -                   | 1                  |
| Minimum supply voltage            | V                   | 230                |
| Maximum supply voltage            | V                   | 230                |
| Power supply frequency            | Hz                  | 50/60              |
| Rated power                       | W                   | 336                |
| Power of electrical reheater      | W                   | 3600               |
| Unit current                      | A                   | 18                 |
| Maximum airflow                   | m <sup>3</sup> /h   | 830                |
| Sound pressure level LpA at 3 m   | dB(A)               | 31                 |
| Heat recovery efficiency, max     | %                   | 89                 |
| Heat exchanger type               | -                   | Counter flow       |
| Heat exchanger material           | -                   | Enthalpy           |
| Weight                            | kg                  | 108.4              |
| Extract filter                    | -                   | G4                 |
| Supply filter                     | -                   | G4+F7              |
| Transported air temperature (max) | °C                  | 40                 |
| Transported air temperature (min) | °C                  | -25                |
| Ambient air temperature min       | °C                  | 1                  |
| Ambient air temperature max       | °C                  | 40                 |
| Ambient air humidity max          | %                   | 80                 |

|  |   |      |
|--|---|------|
| Ingress protection rating              | - | IP22 |
| Ingress protection rating of the drive | - | IP44 |

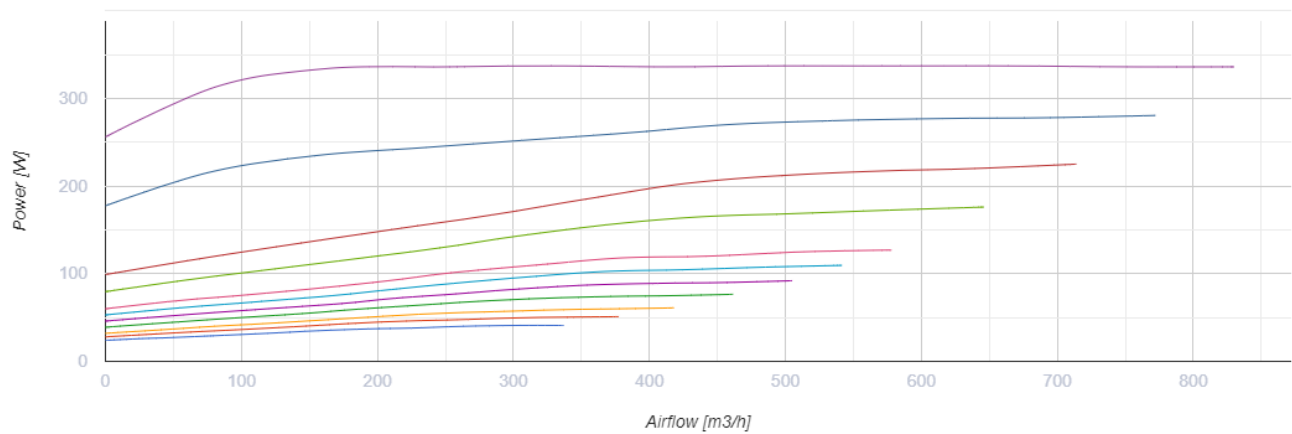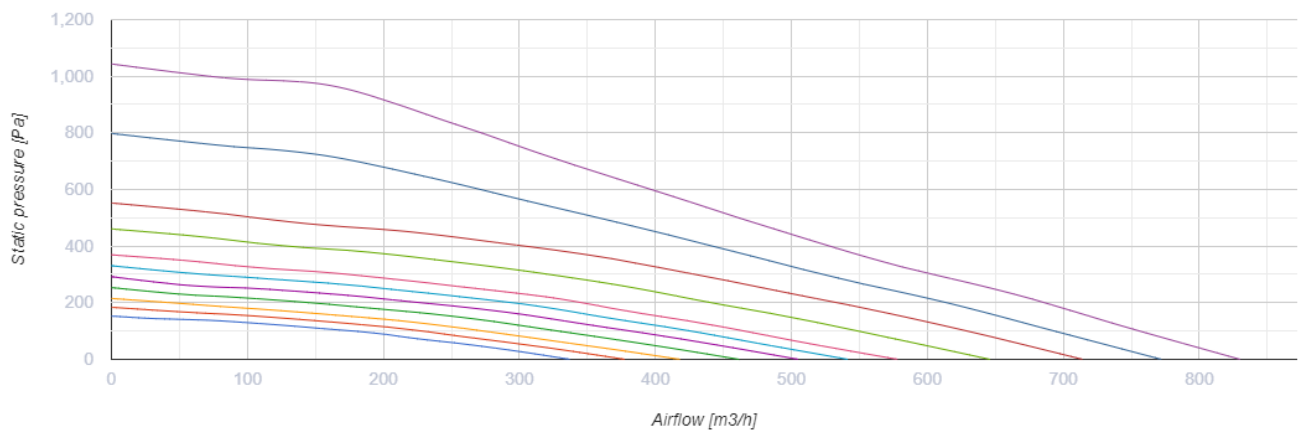




## Dimensions

| ØD  | B   | B1  | B2  | H   | H1  | H2  | L    | L1   |
|-----|-----|-----|-----|-----|-----|-----|------|------|
| 247 | 866 | 274 | 296 | 601 | 234 | 166 | 1282 | 1379 |








## Accessories



### Control Panels for AHU

| Name                     | Photo   | Description   |
|--------------------------|---|---|
| <a href="#">A25</a>      |    | The control panel with a sensor display   |
| <a href="#">A22</a>      |  | The A22/A22 WiFi control panels are used for control of industrial and domestic air handling units with an A21 automation system. |
| <a href="#">A22 WiFi</a> |  | The A22/A22 WiFi control panels are used for control of industrial and domestic air handling units with an A21 automation system. |




### Sensors

| Name                      | Photo   | Description                    |
|---------------------------|---|--------------------------------|
| <a href="#">HV2</a>       |  | Humidity sensor                |
| <a href="#">CO2-1</a>     |  | CO2 sensors                    |
| <a href="#">CO2-2</a>     |  | CO2 sensors                    |
| <a href="#">HR-S</a>      |  | Electro-mechanical humidistats |
| <a href="#">DPWC11200</a> |  | Humidity sensor                |







### VOC sensors

| Name                      | Photo   | Description |
|---------------------------|---|-------------|
| <a href="#">DPWQ30600</a> |  | VOC sensors |
| <a href="#">DPWQ40200</a> |  | CO2 sensor  |

### Electrical heaters



| Name                                  | Photo   | Description                                 |
|---------------------------------------|---|---|
| <a href="#">NKP 250-1,2-1 A21 V.2</a> |  | Heater for heat exchanger freeze protection |
| <a href="#">NKP 250-2,0-1 A21 V.2</a> |  | Heater for heat exchanger freeze protection |
| <a href="#">NKP 250-3,0-1 A21 V.2</a> |  | Heater for heat exchanger freeze protection |

### For round ducts


| Name                         | Photo   | Description   |
|------------------------------|---|---|
| <a href="#">SR 250/600</a>   |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |
| <a href="#">SR 250/900</a>   |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |
| <a href="#">SR 250/1200</a>  |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |
| <a href="#">SRF 250/600</a>  |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |
| <a href="#">SRF 250/900</a>  |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |
| <a href="#">SRF 250/2000</a> |  | Silencer is applied for noise absorption produced during the ventilating equipment operation and spread along the ducting systems |

### For round ducts



| Name | Photo | Description |
|------|-------|-------------|
|------|-------|-------------|

|                         |   |  |
|-------------------------|---|--|
| <a href="#">KOM 250</a> |  | Spring-loaded backdraft damper for round ducts     |
| <a href="#">KRV 250</a> |  | Air damper for air flow cut-off in round air ducts |



### Condensation drainage

| Name                 | Photo   | Description   |
|----------------------|---|---|
| <a href="#">DN-2</a> |  | The drain pump provides extraction and discharge of condensate in ventilation systems |


### Electric actuators

| Name                         | Photo  | Description   |
|------------------------------|--|---|
| <a href="#">Belimo LF230</a> |   | The Belimo LF series actuators are designed for controlling air dampers with cross section up to 0.8 m <sup>2</sup> performing protection functions |
| <a href="#">Belimo TF230</a> |  | The actuators are designed for controlling air dampers with cross section up to 0.4 m <sup>2</sup> performing protection functions                  |

### Other accessories

| Name             | Photo   | Description     |
|------------------|---|-----------------|
| SF 784x253x48 G4 |  | Panel filter G4 |
| SF 784x253x48 F7 |  | F7 panel filter |

## Ecodesign

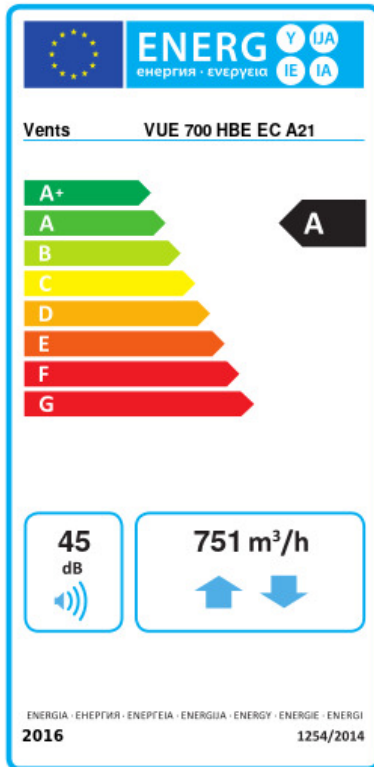

|   |                      |    |         |   |       |   |
|---|----------------------|----|---------|---|-------|---|
| Trademark   | Vents                |    |         |   |       |   |
| Model   | VUE 700 HBE EC A21   |    |         |   |       |   |
| Specific energy consumption (SEC) (kWh/(m <sup>2</sup> /a)) | Cold                 |    | Average |   | Warm  |   |
|   | -77.9                | A+ | -40.8   | A | -16.9 | E |
| Type of ventilation unit                                    | Bidirectional        |    |         |   |       |   |
| Type of drive installed                                     | Variable speed       |    |         |   |       |   |
| Type of heat recovery system                                | Recuperative         |    |         |   |       |   |
| Thermal efficiency of heat recovery (%)                     | 78                   |    |         |   |       |   |
| Maximum flow rate (m <sup>3</sup> /h)                       | 751                  |    |         |   |       |   |
| Electric power input (W)                                    | 336                  |    |         |   |       |   |
| Reference flow rate (m <sup>3</sup> /s)                     | 0.143                |    |         |   |       |   |
| Reference pressure difference (Pa)                          | 50                   |    |         |   |       |   |
| Specific power input (SPI) (W/(m <sup>3</sup> /h))          | 0.243                |    |         |   |       |   |
| Control typology  | Local demand control |    |         |   |       |   |
| Maximum internal leakage rates (%)                          | 2.7                  |    |         |   |       |   |
| Maximum external leakage rates (%)                          | 2.7                  |    |         |   |       |   |
| Sound power level (dB(A))                                   | 45                   |    |         |   |       |   |
| Declared typology   | RVU BVU              |    |         |   |       |   |
| The annual electricity consumption (AEC) (kWh/a)            | Cold                 |    | Average |   | Warm  |   |
|   | 710                  |    | 173     |   | 128   |   |
| The annual heating saved (AHS) (kWh/a)                      | Cold                 |    | Average |   | Warm  |   |
|   | 8695                 |    | 4445    |   | 2010  |   |